

Athens-Clarke County Public Utilities Department
2025 Capital Improvements Element

Project
3-303

Project Name

Water Service Line
Replacement

Project Category


Rehabilitation and
Replacement

Project Cost

\$15,000,000

Key Elements

1. Replace small diameter pipes (2 to 3 inch diameter)
2. Enhance fire protection and improve system reliability by providing large diameter pipes with the ability to provide enough water to fight a fire.

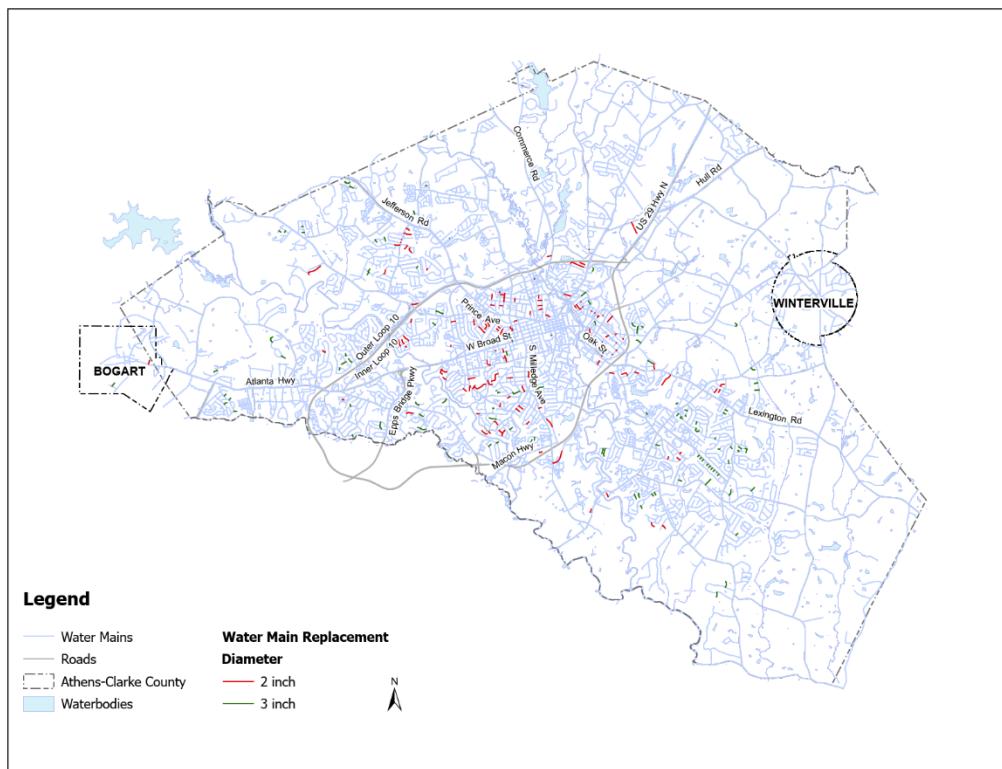

Project Description

Replacement of small diameter (2 inch and 3 inch) water mains to enhance fire protection and improve system reliability. Replace the small diameter distribution pipes with 6 inch or 8-in diameter pipe. Fire hydrants will be added to the new pipe network improving fire-fighting capability for the area. The remaining length of small diameter pipe is approximately 10.7 miles of pipe.