

Fire Sprinkler System Flow Flush Test Request Form

Note: The fee for each flush test is estimated based on equipment rental and water used. The minimum charge is \$250.00. The minimum charge includes 23,400 gallons of water (1,560 gpm for 15 minutes). Leaving any information blank on this form may result in a delay of your flush test. All fees must be paid prior to setting the water meter for the project development.

APPLICANT CONTACT INFORMATION

Request Date: _____ OfficePhone: _____
Contact Name: _____ CellularPhone: _____
Company Name: _____ Email: _____
Mailing Address: _____

FIRE FLOW REQUEST INFORMATION

Project Name: _____ Flowed Pipe Size : _____
Project Street Address: _____ Gaged Meter Size: _____
Cross Street: _____


Check the following indicating these stipulations:

Licensed Utility Contractor will install PUD water meter and provide secured pipe for water disposal.

Flow velocity pitot tube will be provided by the Utility Contractor not to exceed a maximum of 1,560 gpm.

All water main valve operation to access the water in the fire flow line will be conducted by PUD staff.

SKETCH AND COMMENTS

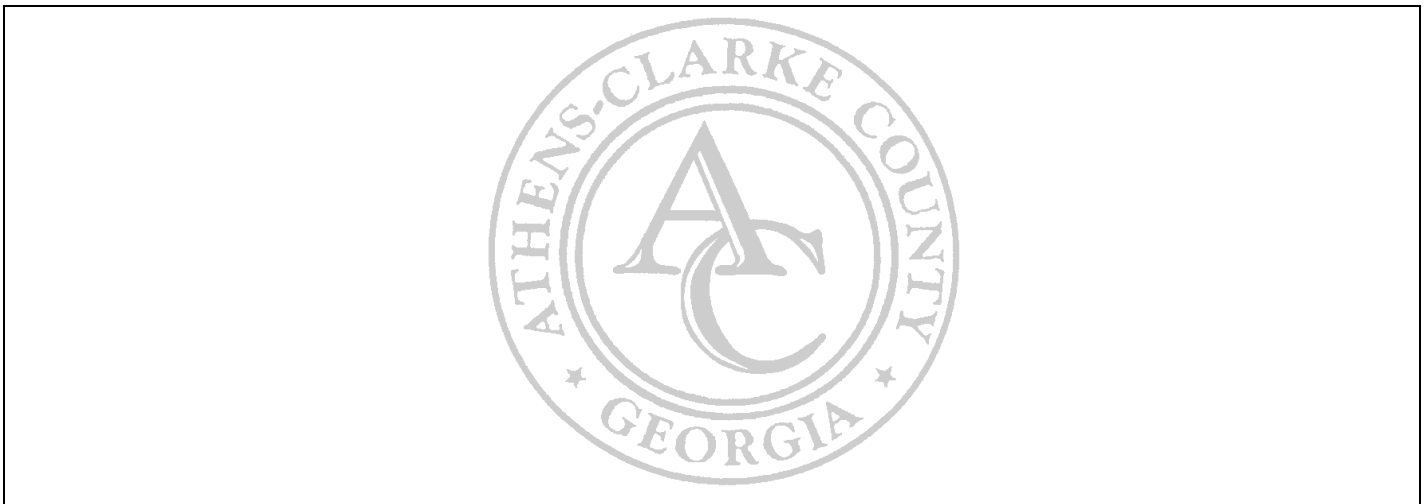

For ACC PUD use only:

_____ Payment Received _____ Flush Completed
_____ Test Requested

Please send to: ACC Public Utilities Department, Engineering Management, 124 E Hancock, Athens, Georgia 30601