


PUMP STATION WET WELL

PLAN

VALVE MANHOLE

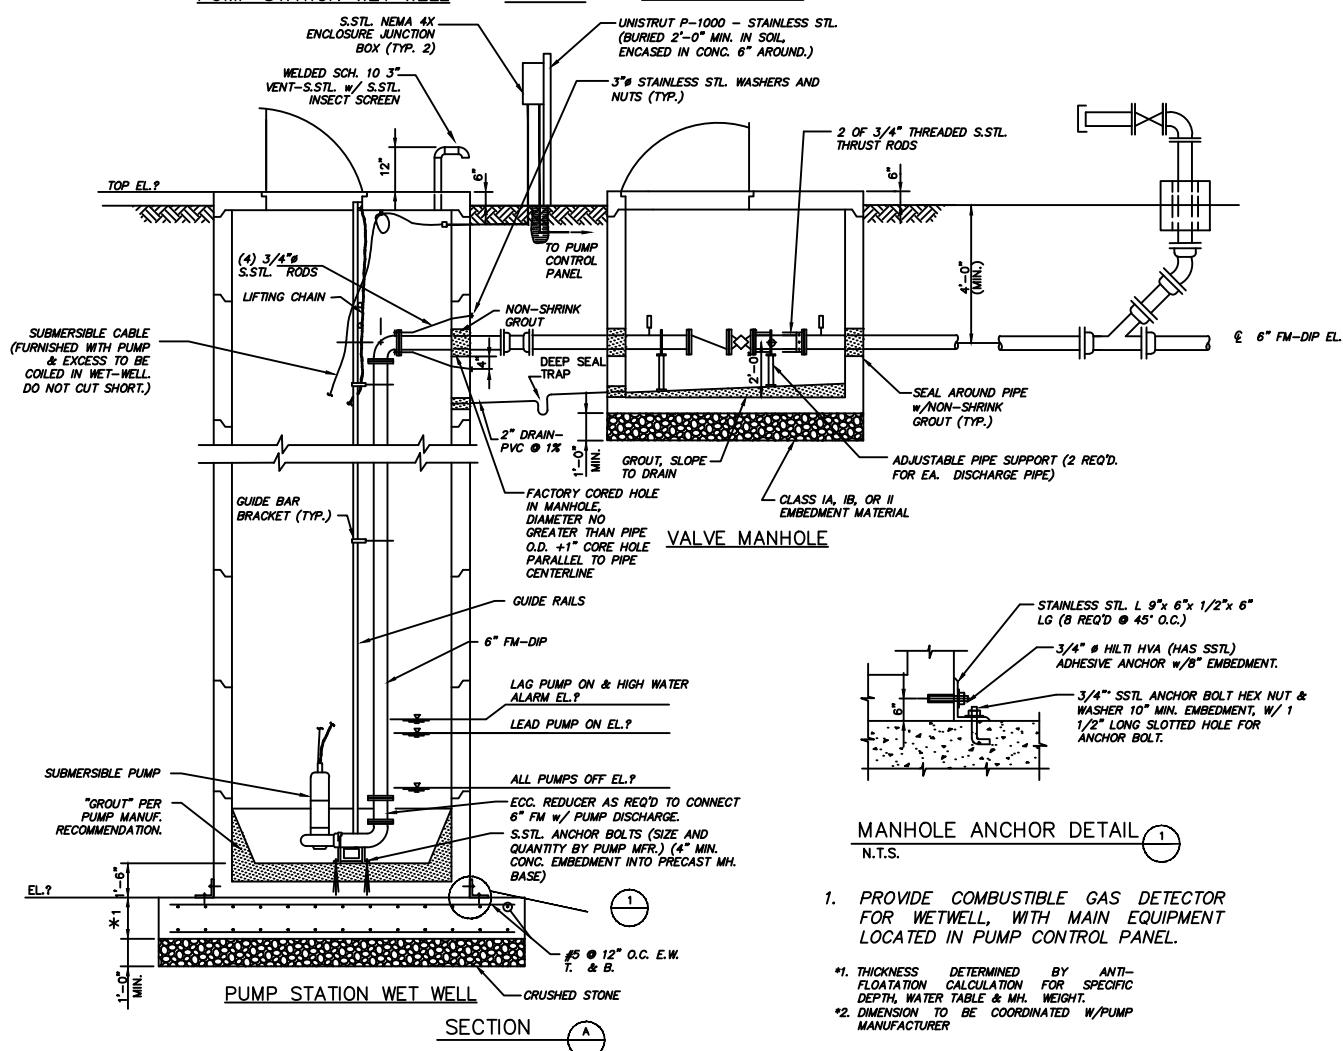

Pump Station (8' diameter wetwell)

NTS

PS-2

Standard Specification and Detail for:

Pumping Station (8' diameter wetwell)

GMD: NA

County: Athens-Clarke

State: Georgia

Date: August, 2019

Drawn by: KFM

Approved by: GJ

Scale: AS-SHOWN

The Unified Government of Athens-Clarke County
Department of Public Utilities

Fax: 706-613-3198

124 E Hancock Ave
Athens, Georgia 30601

Voice: 706-613-3490

