



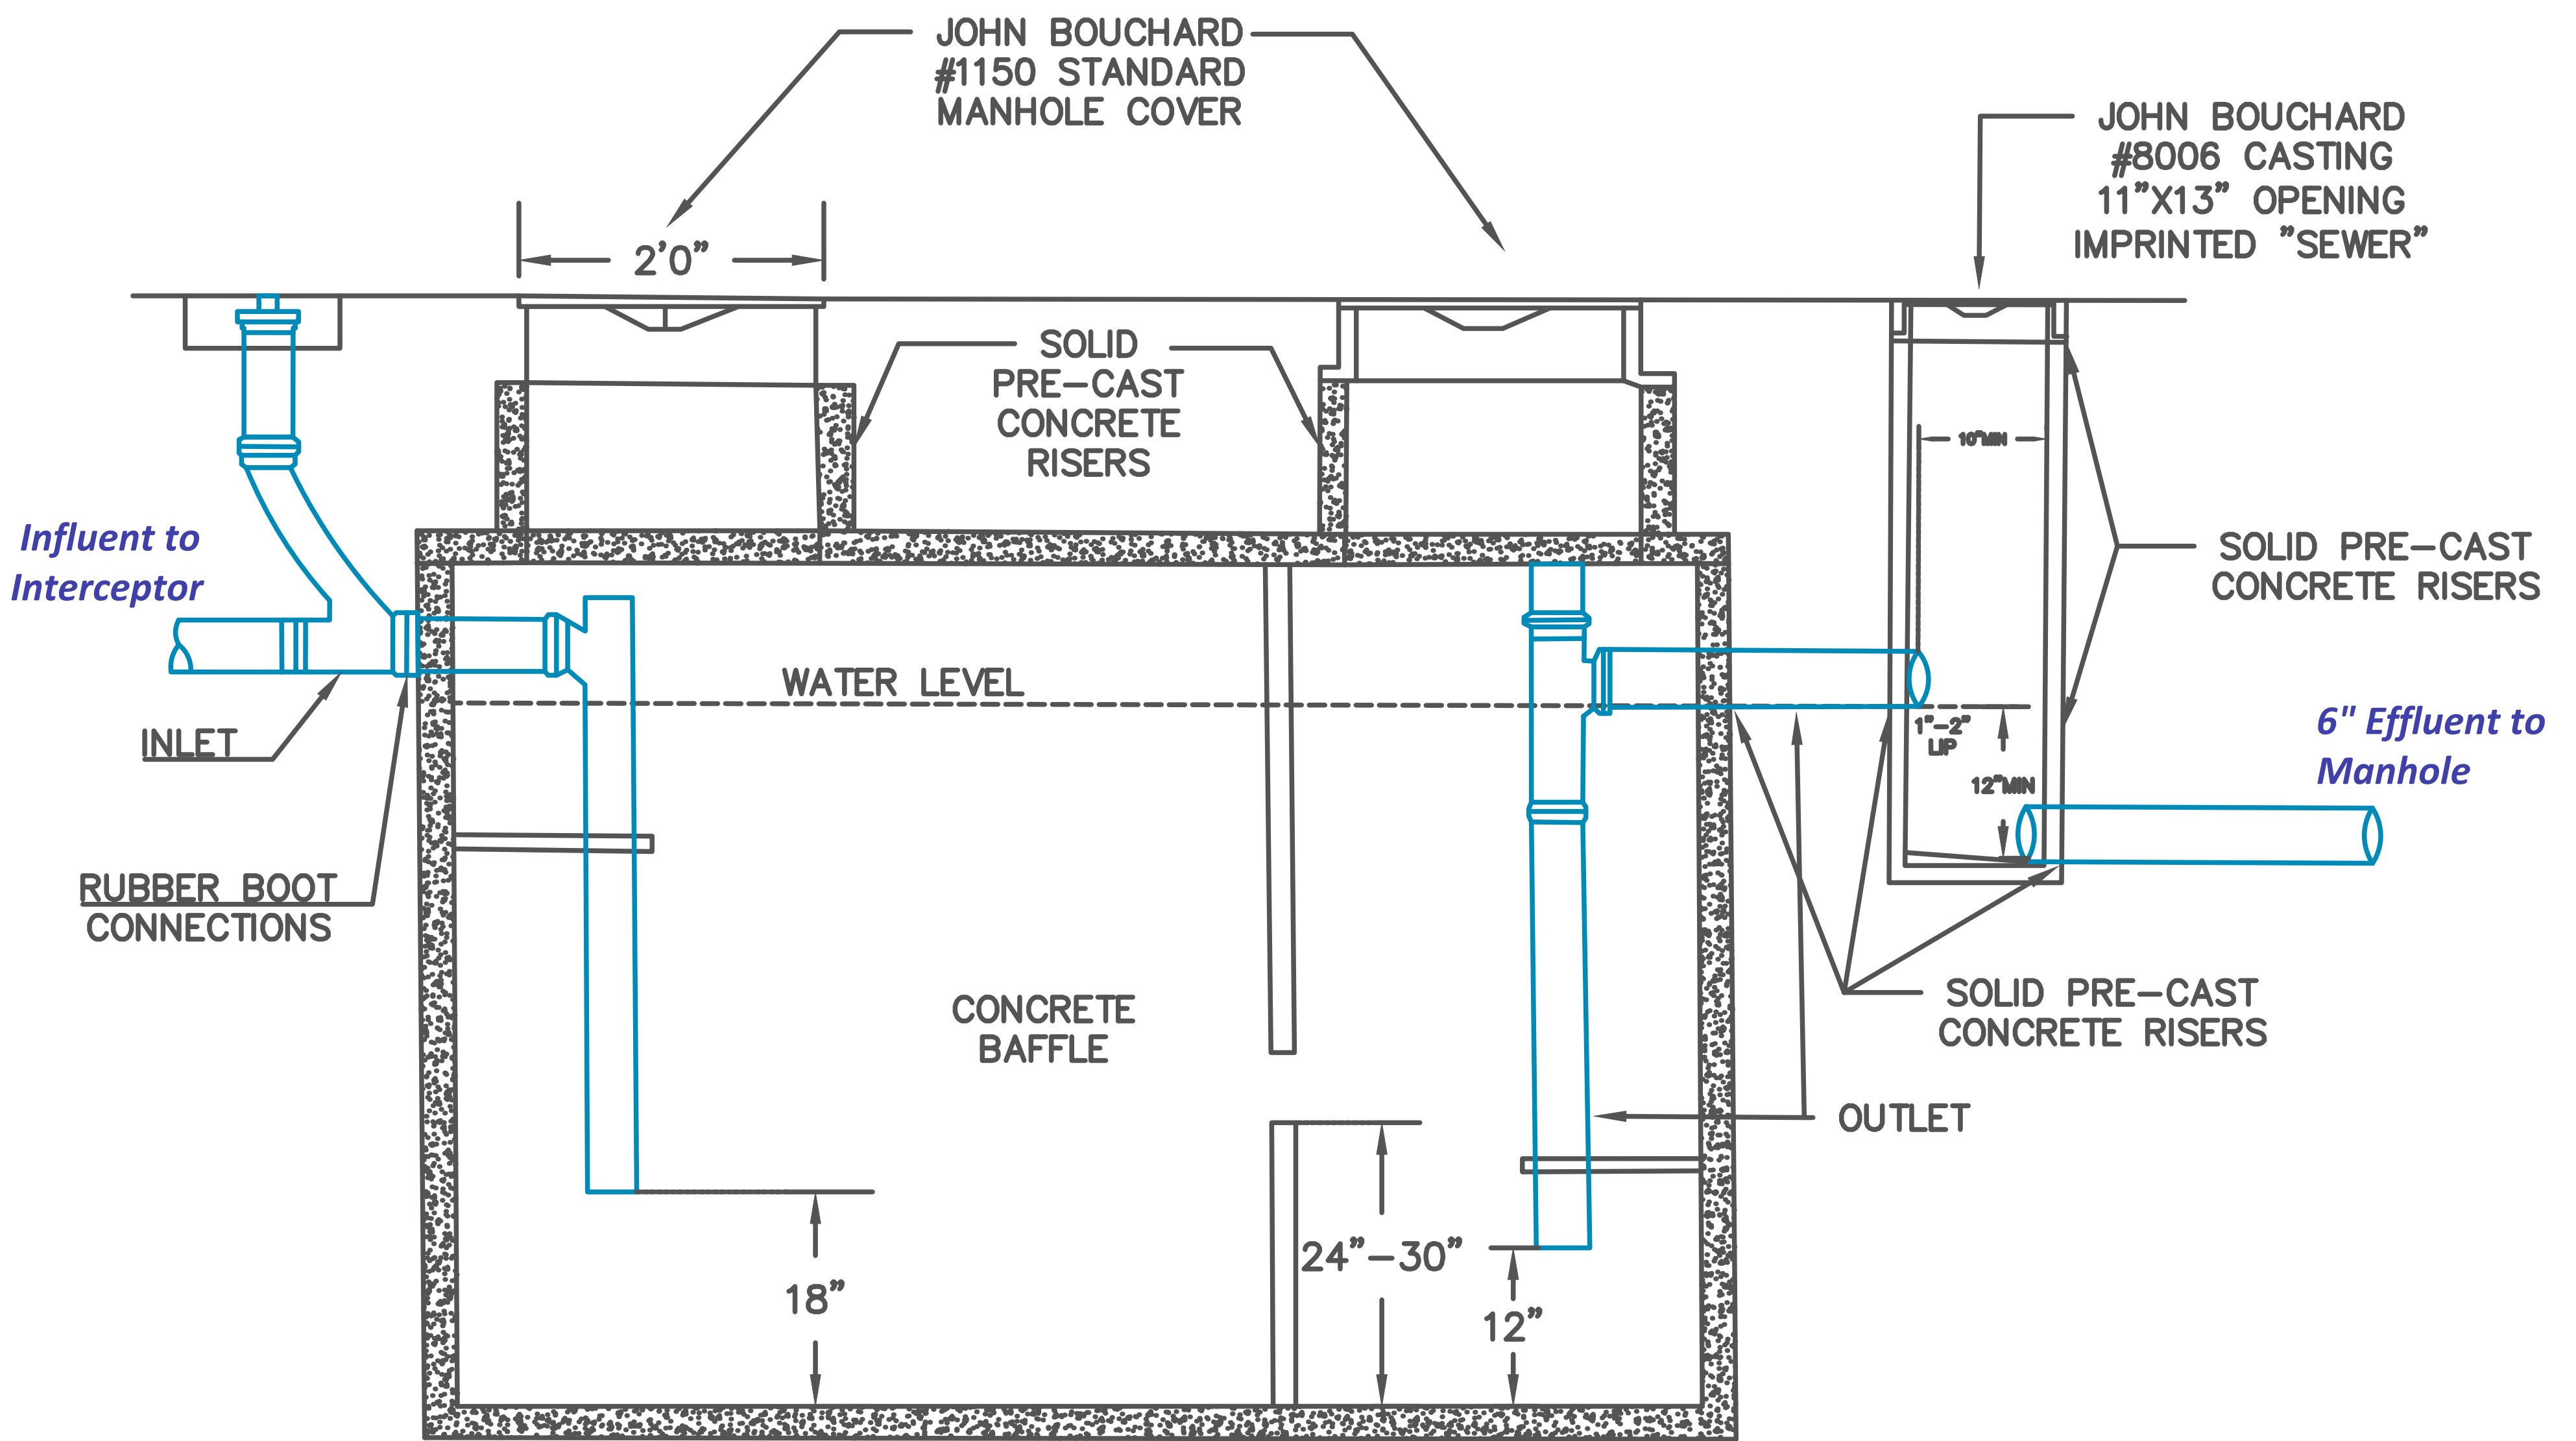

OUTDOOR GREASE INTERCEPTOR

Note:
1,500 Gal. minimum capacity

Indoor grease interceptors are permitted if space limitations do not allow outdoor installations

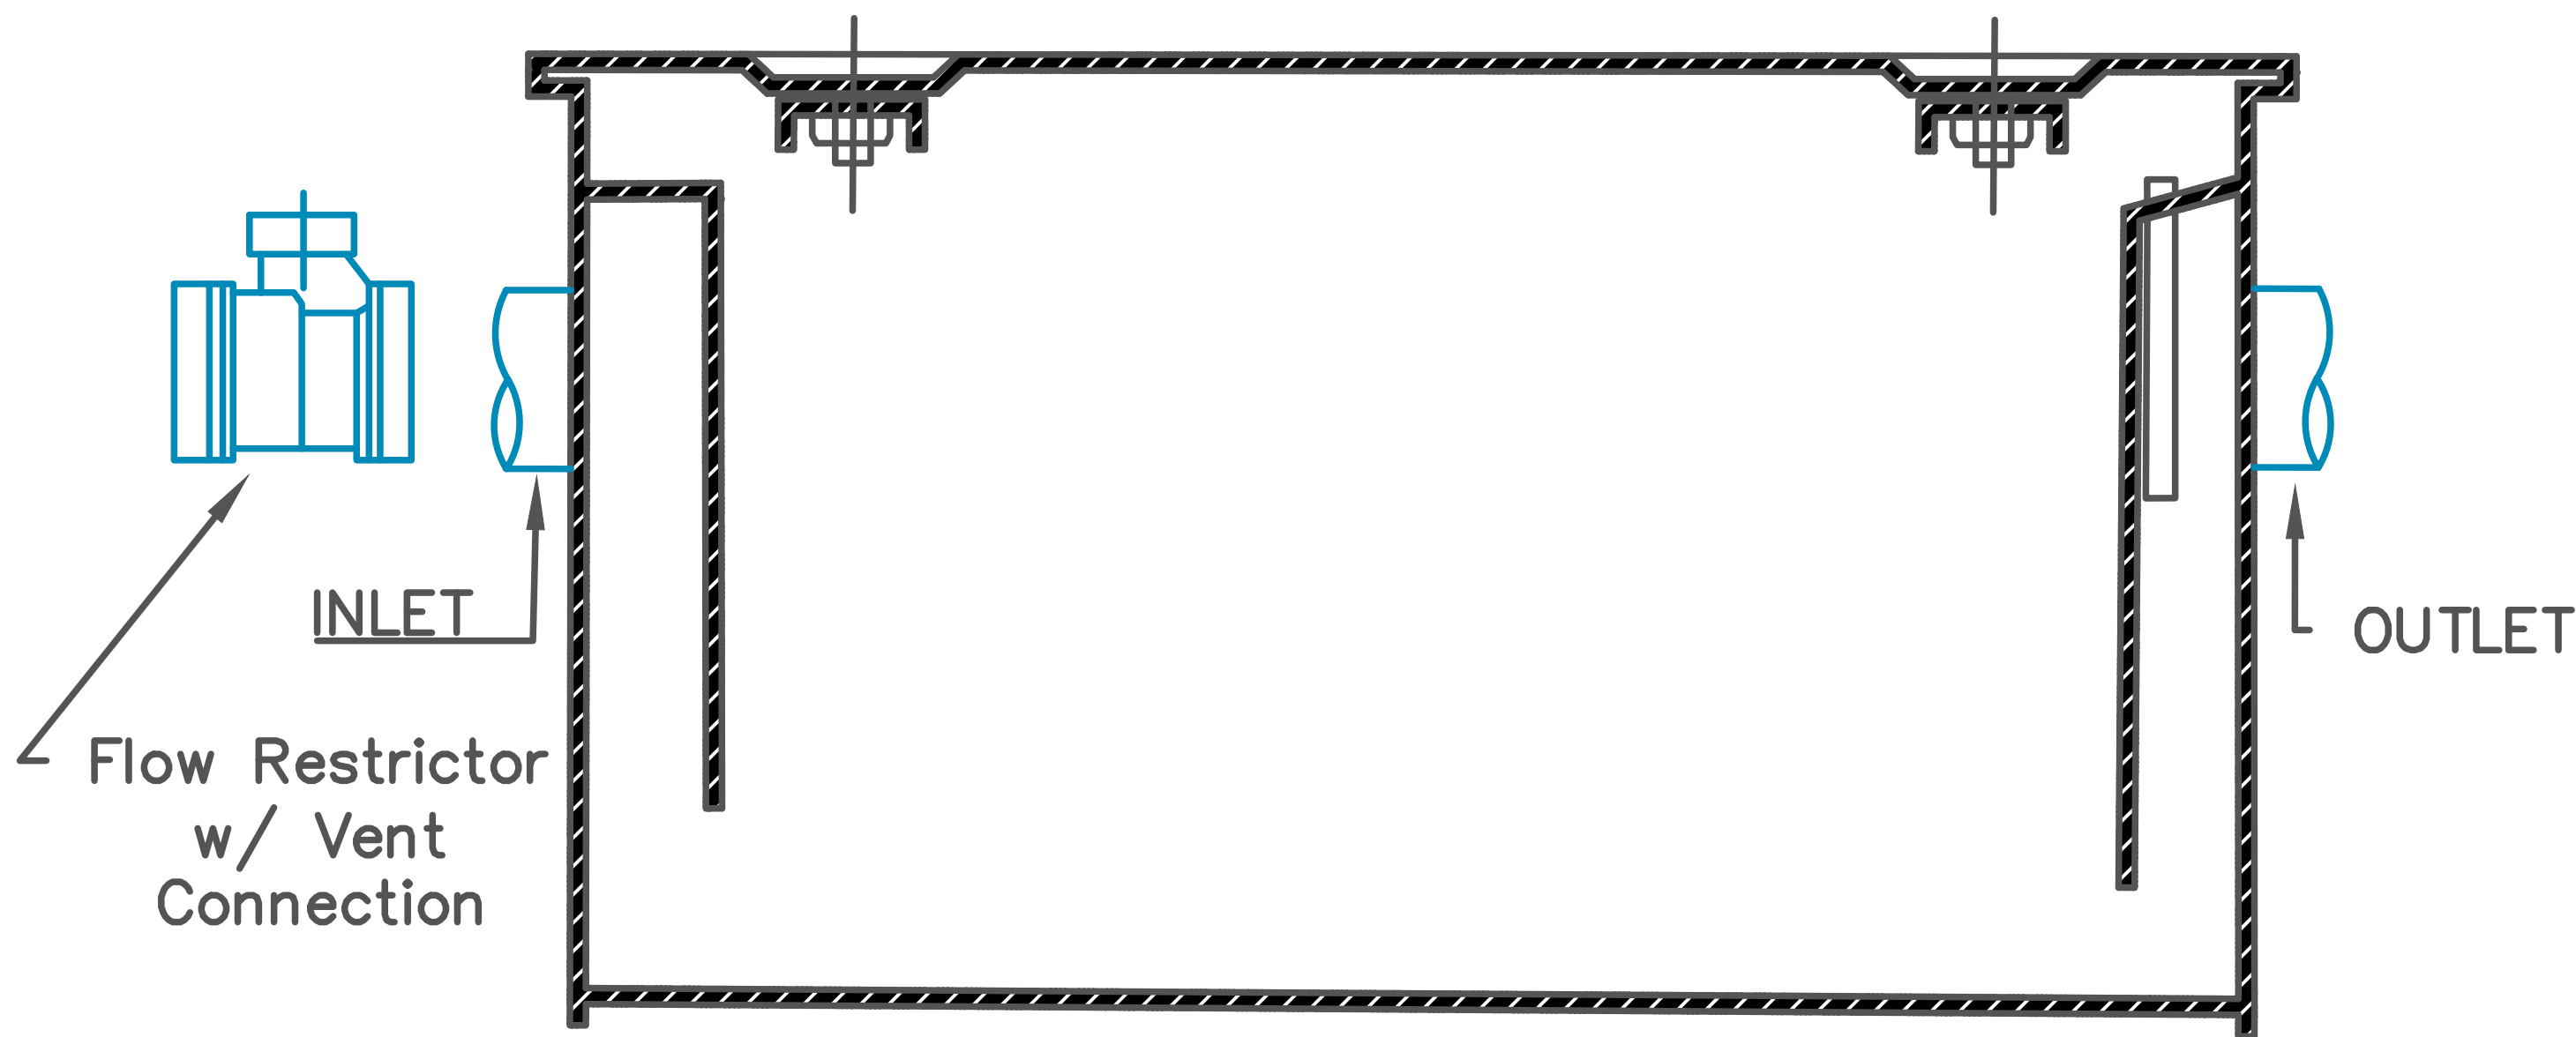

INDOOR GREASE INTERCEPTOR

Note:
40 pound minimum capacity

DRAWING NOT TO SCALE

DRAWING INFO.
MAY 1, 2018
DRAWN BY: ENGINEERING TECH SV
APPROVED BY:
REVISED:
SHEET 1 OF 1

Standard Specification and Detail for:

INDOOR/OUTDOOR GREASE INTERCEPTOR

ATHENS
CLARKE
COUNTY

UNIFIED GOVERNMENT OF ATHENS-CLARKE COUNTY
P.O. BOX 1868 ATHENS, GA. 30613
(706) 613-3470 FAX (706) 613-3476